



Test Report: LAD-240A

240W Economical Security/ Fire Alarm PSU with Battery
Charger/UPS

■ DESIGN VERIFY TEST

Output Function Test
Input Function Test
Protection Function Test
Control Function Test
Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test
E.M.C. Test

■ RELIABILITY TEST


ENVIRONMENT TEST

DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1: 10.8 V~ 14.5 V	I/P : 230 VAC I/P : 115 VAC O/P : MIN LOAD Ta : 25°C	10.466V~15.126V/230VAC 10.471V~15.124V/115VAC
2	OUTPUT VOLTAGE(Max) TOLERANCE	V1: -1.5 %~ +1.5 %	I/P: 90VAC /264VAC O/P:FULL/ MIN. LOAD Ta:25°C	V1: -0.24%~ 0.23%
3	LINE REGULATION (Max)	V1: -0.5 %~ +0.5 %	I/P: 90VAC~ 264VAC O/P:FULL LOAD Ta:25°C	V1: -0.01%~ -0.08%
4	LOAD REGULATION(Max)	V1: -1.0 %~ +1.0 %	I/P: 230VAC O/P:FULL ~MIN LOAD Ta:25°C	V1: -0.24%~ 0.23%
5	OVER/UNDERSHOOT TEST	< ±5%	I/P: 230VAC O/P:FULL LOAD Ta:25°C	3.7%
6	RIPPLE & NOISE(Max)	V1: 150mVp-p	I/P:230VAC O/P: TESTING LOAD Ta:25°C	V1: 71mVp-p

high frequency :

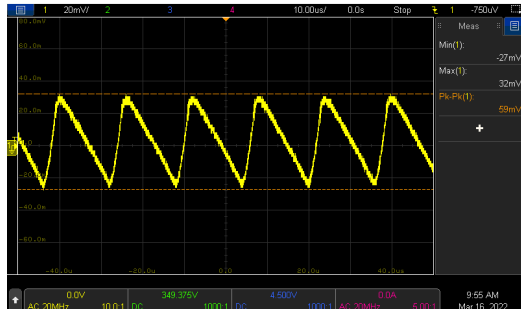


low frequency :

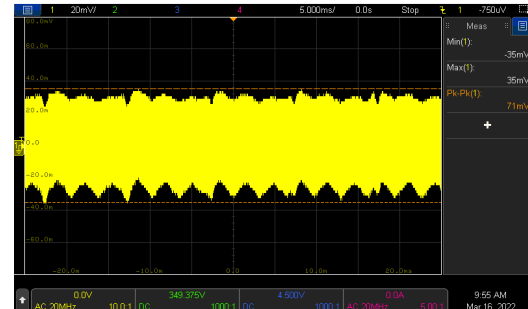








7	SET UP TIME(Max)	230VAC/2000ms 115VAC/2000ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/ 192 ms 115VAC/ 206 ms
---	------------------	--------------------------------	----------------------------------------------------------------	----------------------------------

INPUT=230VAC/50HZ @ FULL LOAD
CH1 : Output Voltage CH2 : AC Input Voltage

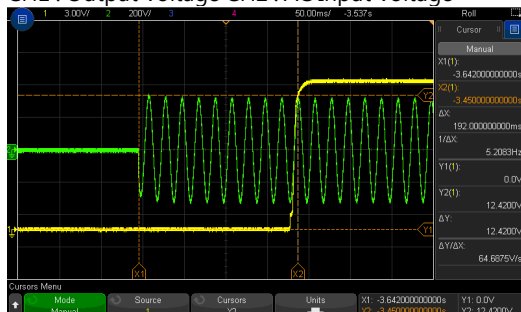

INPUT=115VAC/60HZ @ FULL LOAD
CH1 : Output Voltage CH2 : AC Input Voltage

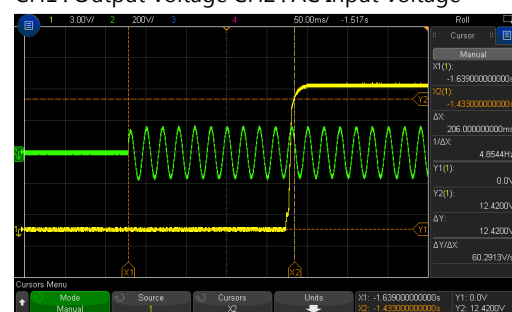


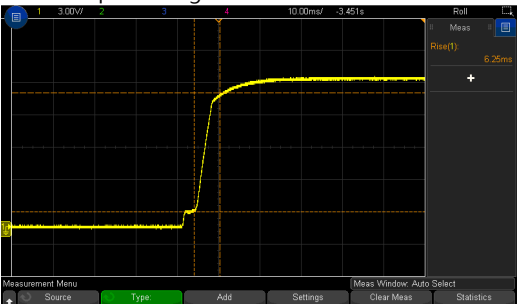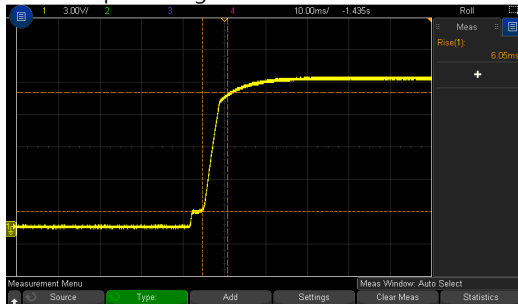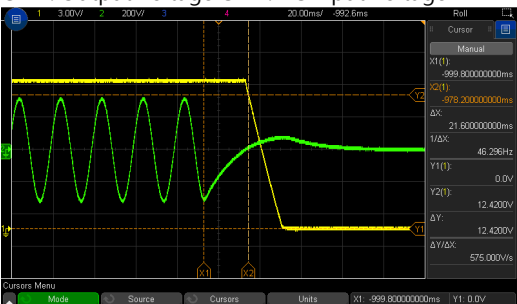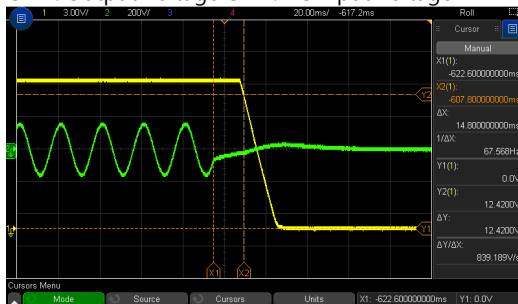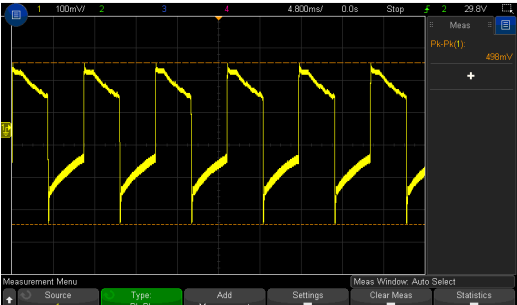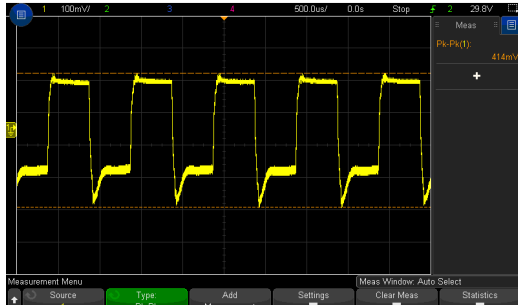8	RISE TIME (Max)	230VAC/50ms 115VAC/50ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/ 6.25 ms 115VAC/ 6.05ms
INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage		INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage		
				
9	HOLD UP TIME (Typ.)	230VAC/16ms 115VAC/12ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/ 21.6 ms 115VAC/ 14.8 ms
INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage		INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage		
				
10	DYNAMIC LOAD	V1: 1380mVp-p	I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta:25°C	498mVp-p 414mVp-p
FULL /50% LOAD 50%DUTY / 120HZ		FULL /50% LOAD 50%DUTY / 1KHZ		
				
11	TRANSIENT RECOVERY TIME	V1: 1380mVp-p	I/P: 230VAC O/P:40% LOAD CHANGE 50%DUTY/120HZ 1.25A/us	275mVp-p



12	Battery static discharge current	After battery low protection <100uA	I/P : 230 VAC O/P : TESTING Ta : 25°C	0 uA
13	BAT RATED CURRENT	1± 0.1A	I/P: 230VAC O/P:CV=12V Ta:25°C	1.005A

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	90 ~ 132VAC / 180 ~ 264VAC by switch 240 ~ 370VDC (Default switch at 230VAC)	(1) I/P:TESTING O/P:FULL LOAD (2) I/P:DC TESTING(L:+ N:-) O/P: FULL / 80% LOAD (switch on 230VAC) (3) I/P:DC TESTING(L:- N:+) O/P: FULL /80% LOAD (switch on 230VAC) Ta:25°C	(1) 86V~132V/ FULL LOAD 82V~132V/ 80% LOAD 165V~264V / FULL LOAD (switch on 230VAC) (2) 228.2Vdc~370Vdc/FULL LOAD 228.2Vdc~370Vdc/80% LOAD (3) 228.2Vdc~370Vdc/FULL LOAD 228.2Vdc~370Vdc/80% LOAD
			I/P: switch on 115VAC : LOW-LINE-3V=87 V HIGH-LINE+15%=150V switch on 230VAC : LOW-LINE-3V=177 V HIGH-LINE+15%=300V VO/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	TEST:OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P: 90 ~ 132VAC / 180 ~ 264VAC by switch O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	INPUT CURRENT (Typ.)	230V/2.4A 115V/ 4.4A	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I =2.29A/ 230VAC I =4.19A/ 115VAC
4	LEAKAGE CURRENT	< 0.5mA / 240 VAC	I/P : 240 VAC O/P : Min LOAD Ta : 25°C	0.409 mA / (PEAK) 0.188 mA / (RMS)
5	EFFICIENCY(Typ.)	85.5%	I/P:230 VAC O/P:FULL LOAD Ta:25°C	85.7 %
	EFFICIENCY vs LOAD			

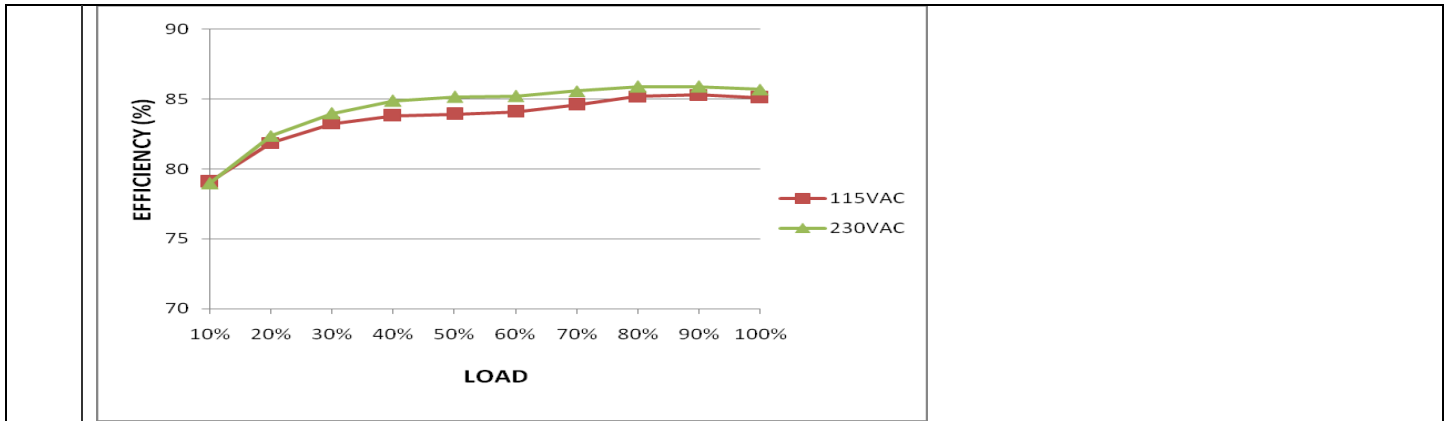

6	INRUSH CURRENT(Typ.)	230V/60A 115V/60A COLD START	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I =50.6A/ 230VAC T50= 648us /230V I =56.0A/ 115VAC T50= 728us/ 230V
	<p>INPUT=230VAC/50HZ @ FULL LOAD INPUT=115VAC/ 60HZ @ FULL LOAD</p> <p>CH2 : AC Input Voltage CH4 : Input current CH2 : AC Input Voltage CH4 : Input current</p>			

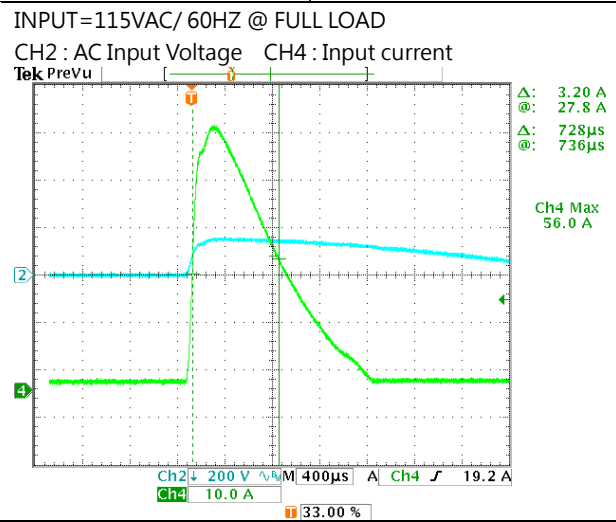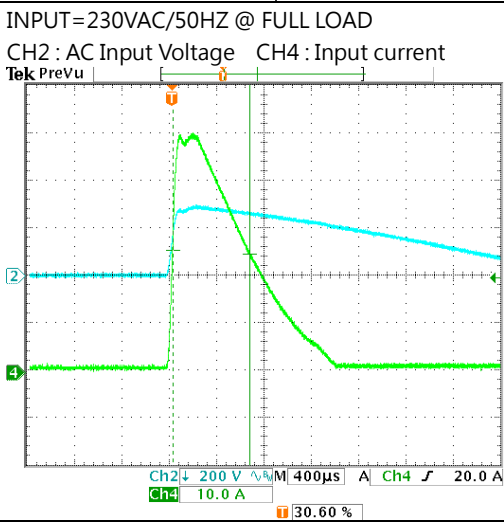

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	CH1 : 105%~135% CH2 : 90 ~ 110% Protection type : CH1 OLP, CH2 with battery: The unit will enter to UPS mode when CH1 is around 105%~120%, when total output of CH1 + CH2 reach around 125%~135% output shuts down CH1 OLP, CH2 without battery: Shut down o/p voltage, re-power on to removed CH2 : Constant current	I/P: 264VAC I/P: 230VAC I/P: 100VAC O/P: TESTING Ta:25°C	119.8% / 264VAC 119.1%/ 230VAC 118.2%/100VAC Protection type : CH1 OLP, CH2 with battery: The unit will enter to UPS mode when CH1 is around 105%~120%, when total output of CH1 + CH2 reach around 125%~135% output shuts down CH1 OLP, CH2 without battery: Shut down o/p voltage, re-power on to removed CH2 : Constant current limiting;



		limiting; fault condition does not affect CH1 working, recovers automatically after fault condition is removed (External fuse is mandatory in series connection with battery for protection)		fault condition does not affect CH1 working, recovers automatically after fault condition is removed (External fuse is mandatory in series connection with battery for protection)
2	OVER VOLTAGE PROTECTION	CH1: 15.5V~18V Protection type : Shut down o/p voltage , re-power on to removed	I/P: 264VAC I/P: 230VAC I/P: 90VAC O/P:MIN LOAD Ta:25°C	16.1V/ 264VAC 16.4V/ 230VAC 16.4V/ 90VAC Protection type : Shut down o/p voltage , re-power on to removed
3	OVER TEMPERATURE PROTECTION	Protection type : Shut down o/p voltage , re-power on to removed	I/P: 264VAC I/P: 90VAC O/P:FULL LOAD	O.T.P. Active OK Protection type : Shut down o/p voltage , re-power on to removed
4	BATTERY CUTOFF	9.5±0.5V	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	9.8 V
5	BATTERY REVERSE POLARITY	Protection type : Protected when reverse polarity , no damage, recovers automatically after fault condition is removed	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	TEST : <u>OK</u>

CONTROL FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	AC OK	TTL signal, High / Open : AC Fail ; Low : AC OK ; Ice : max. 30mA@ 50VDC	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	Test: <u>OK</u>
2	DISCHARGE	TTL signal, High / Open : Charge ; Low : Discharge ; Ice : max. 30mA@ 50VDC	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	Test: <u>OK</u>
3	BATTERY FULL	TTL signal, High / Open : Battery charging ; Low : Battery full ; Ice : max. 30mA@ 50VDC	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	Test: <u>OK</u>
4	BATTERY DISCONNECT/ REVERSE POLARITY	TTL signal, High / Open : Battery connect/normal ; Low : Battery disconnect/reverse polarity; Ice : max. 30mA@ 50VDC	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	Test: <u>OK</u>
5	BATTERY LOW	TTL signal, High / Open : Battery normal ; Low : Battery low; Ice : max. 30mA@ 50VDC	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	Test: <u>OK</u>



6	FORCE START	CN2: PIN7&PIN8 SHORT	I/P: 230 VAC O/P:BAT. LOAD Ta:25°C	TEST : <u>OK</u>
---	-------------	----------------------	------------------------------------------	------------------

COMPONENT STRESS TEST

1	PWM Transistor (D to S) or (C to E) Peak Voltage	Q 1/Q2 Rated : 13 A/ 600 V	AC ON/OFF I/P: High-Line +3V =267V VDS: O/P:(1) Full Load (2) Output Short (3) Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4) Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5) Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6) Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. Ta:25°C	Q1 VDS: (1) 468V (2) 496V (3) 468V (4) 468V (5) 468V (6) 468V (7) 496V	Q2 VDS: (1) 472V (2) 512V (3) 472V (4) 472V (5) 472V (6) 472V (7) 500V
2	Diode Peak Voltage	D101 /D102 Rated : 30A/ 150 V	AC ON/OFF I/P:High-Line +3V =267V <u>Vo=Vmax</u> O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. (8).NO LOAD <u>Vo=Vnormal</u> O/P: (1)Full Load Ta:25°C	D101: <u>Vo=Vmax</u> VDS: (1) 133V (2) 140V (3) 133V (4) 133V (5) 133V (6) 135V (7) 138V (8) 118V <u>Vo=Vnormal</u> (1) 132V	D102: <u>Vo=Vmax</u> VDS: (1) 138V (2) 143V (3) 134V (4) 137V (5) 136V (6) 135V (7) 138V (8) 124V <u>Vo=Vnormal</u> (1) 136V
3	BAT BUCK Transistor (D to S) or (C to E) Peak Voltage	Q 304 Rated : 12A/60V	AC ON/OFF I/P:High-Line +3V = 267 V VDS : O/P: (1)CV (max)-1 (2)CV(min)=10.5V (3)no load (4)OUTPUT SHORT Ta:25°C	Q304 VDS : (1) 21.7V (2) 22.3V (3) 21.4V (4) 23.3V	

4	BAT BUCK Diode Peak Voltage	D320 Rated : 5A/ 100V	AC ON/OFF I/P:High-Line +3V = 267 V VDS : O/P: (1)CV (max)-1 (2)CV(min)=10.5V (3)no load (4)OUTPUT SHORT Ta:25°C	D320 VDS : (1) 22.6V (2) 20.3V (3) 21.7V (4) 22.3V
5	Input Capacitor Voltage	C5/C6 Rated: : 330 μ / 200 V	I/P:High-Line +3V =267V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change (4)Full load continue Ta:25°C	C5 (1)198V (2)192V (3)192V (4)192V C6 (1)198V (2)194V (3)194V (4)194V
6	Control IC Voltage Test	PWM IC U1 Rated 8V~28V BAT BUCK IC U304 Rated 8.4V~30V	AC ON/OFF U1: I/P:High-Line +3V =267V O/P:(1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. (5)NO LOAD VRmin(Low LINE) U304: I/P:High-Line +3V = 267 V VDS : O/P: (1)CV (max)-1 (2)CV(min)=21V (3)no load (4)OUTPUT SHORT Ta:25°C	U1 (1) 19.4V (2) 19.6V (3) 19.4V (4) 19.2V (5) 19.2V U304 (1) 12.44V (2) 12.44V (3) 12.44V (4) 12.44V

■ SAFETY& E.M.C. TEST

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 3KVAC/min I/P-FG :2KVAC/min O/P-FG:0.5KVAC/min	I/P-O/P: 3.6 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG:0.6 KVAC/min Ta:25°C	I/P-O/P: 2.51mA I/P-FG: 2.22mA O/P-FG: 2.68mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P:500VDC>100M Ω I/P-FG: 500VDC>100M Ω O/P-FG:500VDC>100M Ω	I/P-O/P: 600 VDC I/P-FG: 600 VDC O/P-FG: 600 VDC Ta:25°C	I/P-O/P: 9999M Ω I/P-FG: 9999M Ω O/P-FG: 9999M Ω NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100m Ω	40A / 2min Ta:25°C	8m Ω

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	CONDUCTION	BS EN/EN55032 (CISPR32), EAC TP TC 020 CLASS A	I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab
2	RADIATION	BS EN/EN55032 (CISPR32), EAC TP TC 020 CLASS A	I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab
3	E.S.D	BS EN/EN61000-4-2 Level 3, 8KV air Level 2, 6KV contact	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
4	E.F.T	BS EN/EN61000-4-4 INPUT : 2KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
5	SURGE	BS EN/EN61000-4-5 Level 3, 1KV/Line-Line 2KV/Line-FG	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
6	Test by certified Lab & Test Report Prepare Any contradictions of the test results, please refer to the latest EMC test report			

■ RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																												
1	TEMPERATURE RISE TEST	MODEL : LAD-240A 1. ROOM AMBIENT BURN-IN : 2 HRS I/P : 230VAC O/P : FULL LOAD Ta= 25 °C 2. HIGH AMBIENT BURN-IN : 2 HRS I/P : 230VAC O/P : FULL LOAD Ta= 50 °C																																														
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 25 °C</th> <th>HIGH AMBIENT Ta= 50 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>ZNR1</td><td>34.7°C</td><td>60.4°C</td></tr> <tr><td>2</td><td>BD1</td><td>41.2°C</td><td>64.4°C</td></tr> <tr><td>3</td><td>C5</td><td>31.4°C</td><td>56.8°C</td></tr> <tr><td>4</td><td>RTH1</td><td>68.5°C</td><td>85.9°C</td></tr> <tr><td>5</td><td>C37</td><td>27.5°C</td><td>54.0°C</td></tr> <tr><td>6</td><td>T2</td><td>27.7°C</td><td>54.8°C</td></tr> <tr><td>7</td><td>Q2</td><td>41.5°C</td><td>70.2°C</td></tr> <tr><td>8</td><td>Q1</td><td>41.7°C</td><td>70.9°C</td></tr> <tr><td>9</td><td>D10</td><td>31.8°C</td><td>58.9°C</td></tr> <tr><td>10</td><td>R18</td><td>37.4°C</td><td>63.8°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 25 °C	HIGH AMBIENT Ta= 50 °C	1	ZNR1	34.7°C	60.4°C	2	BD1	41.2°C	64.4°C	3	C5	31.4°C	56.8°C	4	RTH1	68.5°C	85.9°C	5	C37	27.5°C	54.0°C	6	T2	27.7°C	54.8°C	7	Q2	41.5°C	70.2°C	8	Q1	41.7°C	70.9°C	9	D10	31.8°C	58.9°C	10	R18	37.4°C	63.8°C
NO	Position	ROOM AMBIENT Ta= 25 °C	HIGH AMBIENT Ta= 50 °C																																													
1	ZNR1	34.7°C	60.4°C																																													
2	BD1	41.2°C	64.4°C																																													
3	C5	31.4°C	56.8°C																																													
4	RTH1	68.5°C	85.9°C																																													
5	C37	27.5°C	54.0°C																																													
6	T2	27.7°C	54.8°C																																													
7	Q2	41.5°C	70.2°C																																													
8	Q1	41.7°C	70.9°C																																													
9	D10	31.8°C	58.9°C																																													
10	R18	37.4°C	63.8°C																																													



		<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 25 °C</th> <th>HIGH AMBIENT Ta= 50 °C</th> </tr> </thead> <tbody> <tr><td>11</td><td>U305</td><td>43.0°C</td><td>69.0°C</td></tr> <tr><td>12</td><td>T1coil</td><td>59.1°C</td><td>85.5°C</td></tr> <tr><td>13</td><td>T1core</td><td>47.7°C</td><td>73.8°C</td></tr> <tr><td>14</td><td>U2</td><td>37.4°C</td><td>63.8°C</td></tr> <tr><td>15</td><td>L101</td><td>40.0°C</td><td>67.3°C</td></tr> <tr><td>16</td><td>D101</td><td>65.2°C</td><td>91.1°C</td></tr> <tr><td>17</td><td>Q405</td><td>36.9°C</td><td>63.5°C</td></tr> <tr><td>18</td><td>L100</td><td>54.9°C</td><td>82.8°C</td></tr> <tr><td>19</td><td>Q305</td><td>44.1°C</td><td>70.1°C</td></tr> <tr><td>20</td><td>D102</td><td>91.8°C</td><td>116.9°C</td></tr> <tr><td>21</td><td>RTH3</td><td>50.7°C</td><td>77.8°C</td></tr> <tr><td>22</td><td>C1</td><td>36.4°C</td><td>61.6°C</td></tr> <tr><td>23</td><td>C110</td><td>44.2°C</td><td>70.3°C</td></tr> <tr><td>24</td><td>LF2</td><td>38.3°C</td><td>63.3°C</td></tr> <tr><td>25</td><td>C105</td><td>42.3°C</td><td>68.5°C</td></tr> <tr><td>26</td><td>RY101</td><td>38.5°C</td><td>65.2°C</td></tr> <tr><td>27</td><td>L301</td><td>40.2°C</td><td>66.7°C</td></tr> <tr><td>28</td><td>U401</td><td>37.8°C</td><td>64.6°C</td></tr> <tr><td>29</td><td>U400</td><td>39.5°C</td><td>66.4°C</td></tr> <tr><td>30</td><td>C347</td><td>41.1°C</td><td>67.0°C</td></tr> <tr><td>31</td><td>U1</td><td>30.7°C</td><td>57.5°C</td></tr> <tr><td>32</td><td>Q305</td><td>35.1°C</td><td>61.5°C</td></tr> <tr><td>33</td><td>D30</td><td>34.0°C</td><td>60.2°C</td></tr> <tr><td>34</td><td>D200</td><td>43.0°C</td><td>68.9°C</td></tr> <tr><td>35</td><td>Q200</td><td>56.5°C</td><td>82.5°C</td></tr> <tr><td>36</td><td>Q304</td><td>46.5°C</td><td>72.8°C</td></tr> <tr><td>37</td><td>J107</td><td>64.1°C</td><td>90.2°C</td></tr> <tr><td>38</td><td>U304</td><td>50.2°C</td><td>78.0°C</td></tr> <tr><td>39</td><td>R101</td><td>53.0°C</td><td>80.9°C</td></tr> <tr><td>40</td><td>R113</td><td>69.1°C</td><td>95.5°C</td></tr> <tr><td>41</td><td>D320</td><td>47.5°C</td><td>73.6°C</td></tr> <tr><td>42</td><td>J108</td><td>49.5°C</td><td>76.9°C</td></tr> <tr><td>43</td><td>U6</td><td>44.6°C</td><td>71.5°C</td></tr> </tbody> </table>				NO	Position	ROOM AMBIENT Ta= 25 °C	HIGH AMBIENT Ta= 50 °C	11	U305	43.0°C	69.0°C	12	T1coil	59.1°C	85.5°C	13	T1core	47.7°C	73.8°C	14	U2	37.4°C	63.8°C	15	L101	40.0°C	67.3°C	16	D101	65.2°C	91.1°C	17	Q405	36.9°C	63.5°C	18	L100	54.9°C	82.8°C	19	Q305	44.1°C	70.1°C	20	D102	91.8°C	116.9°C	21	RTH3	50.7°C	77.8°C	22	C1	36.4°C	61.6°C	23	C110	44.2°C	70.3°C	24	LF2	38.3°C	63.3°C	25	C105	42.3°C	68.5°C	26	RY101	38.5°C	65.2°C	27	L301	40.2°C	66.7°C	28	U401	37.8°C	64.6°C	29	U400	39.5°C	66.4°C	30	C347	41.1°C	67.0°C	31	U1	30.7°C	57.5°C	32	Q305	35.1°C	61.5°C	33	D30	34.0°C	60.2°C	34	D200	43.0°C	68.9°C	35	Q200	56.5°C	82.5°C	36	Q304	46.5°C	72.8°C	37	J107	64.1°C	90.2°C	38	U304	50.2°C	78.0°C	39	R101	53.0°C	80.9°C	40	R113	69.1°C	95.5°C	41	D320	47.5°C	73.6°C	42	J108	49.5°C	76.9°C	43	U6	44.6°C	71.5°C
NO	Position	ROOM AMBIENT Ta= 25 °C	HIGH AMBIENT Ta= 50 °C																																																																																																																																										
11	U305	43.0°C	69.0°C																																																																																																																																										
12	T1coil	59.1°C	85.5°C																																																																																																																																										
13	T1core	47.7°C	73.8°C																																																																																																																																										
14	U2	37.4°C	63.8°C																																																																																																																																										
15	L101	40.0°C	67.3°C																																																																																																																																										
16	D101	65.2°C	91.1°C																																																																																																																																										
17	Q405	36.9°C	63.5°C																																																																																																																																										
18	L100	54.9°C	82.8°C																																																																																																																																										
19	Q305	44.1°C	70.1°C																																																																																																																																										
20	D102	91.8°C	116.9°C																																																																																																																																										
21	RTH3	50.7°C	77.8°C																																																																																																																																										
22	C1	36.4°C	61.6°C																																																																																																																																										
23	C110	44.2°C	70.3°C																																																																																																																																										
24	LF2	38.3°C	63.3°C																																																																																																																																										
25	C105	42.3°C	68.5°C																																																																																																																																										
26	RY101	38.5°C	65.2°C																																																																																																																																										
27	L301	40.2°C	66.7°C																																																																																																																																										
28	U401	37.8°C	64.6°C																																																																																																																																										
29	U400	39.5°C	66.4°C																																																																																																																																										
30	C347	41.1°C	67.0°C																																																																																																																																										
31	U1	30.7°C	57.5°C																																																																																																																																										
32	Q305	35.1°C	61.5°C																																																																																																																																										
33	D30	34.0°C	60.2°C																																																																																																																																										
34	D200	43.0°C	68.9°C																																																																																																																																										
35	Q200	56.5°C	82.5°C																																																																																																																																										
36	Q304	46.5°C	72.8°C																																																																																																																																										
37	J107	64.1°C	90.2°C																																																																																																																																										
38	U304	50.2°C	78.0°C																																																																																																																																										
39	R101	53.0°C	80.9°C																																																																																																																																										
40	R113	69.1°C	95.5°C																																																																																																																																										
41	D320	47.5°C	73.6°C																																																																																																																																										
42	J108	49.5°C	76.9°C																																																																																																																																										
43	U6	44.6°C	71.5°C																																																																																																																																										
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 230 VAC O/P : 118.8%LOAD Ta : 25°C	TEST : OK																																																																																																																																									
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 264VAC/100VAC O/P : 100 %LOAD Ta= -25°C	TEST : OK																																																																																																																																									
4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C/95 %R.H NO DAMAGE	I/P : 272 VAC O/P : FULL LOAD Ta= 51 °C HUMIDITY= 95 %R.H	TEST : OK																																																																																																																																									
5	TEMPERATURE	±0.03%/°C(0~50°C)	I/P : 230 VAC	±0.0081%/°C(0~50°C)																																																																																																																																									



	COEFFICIENT		O/P : FULL LOAD	
6	STORAGE TEMPERATURE TEST	-30~85°C	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : STATIC	
7	THERMAL SHOCK TEST	-20~50°C	1. Thermal shock Temperature : -25°C~ +55°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/Output condition : 15cycle:230V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST 1cycle:230V/ FULL LOAD Burn In Test	
8	VIBRATION TEST	10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 12min/sweep cycle (4) Acceleration : 6G (5) Test Time : 180min in each axis (X.Y.Z) (6) Ta : 25°C	
9	CAPACITOR LIFE CYCLE	SUPPOSE C110 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta= 50 °C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta= 50 °C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta= 50 °C LIFE TIME	(1) 782236.4HRS (2) 128129.7HRS (3) 215098.7HRS (4) 306807.1HRS	
10	MTBF	Conducted by Parts Stress Analysis Prediction 1394.9K hrs min. Telcordia SR-332 (Bellcore); 156.7K hrs min. MIL-HDBK-217F (25°C)		
11	Ongoing Reliability Test	I/P : 230VAC O/P : FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 30,000 hours		

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	Yuwei	Liutt	Wangdz

2020.10.1 TAG-QA-009